
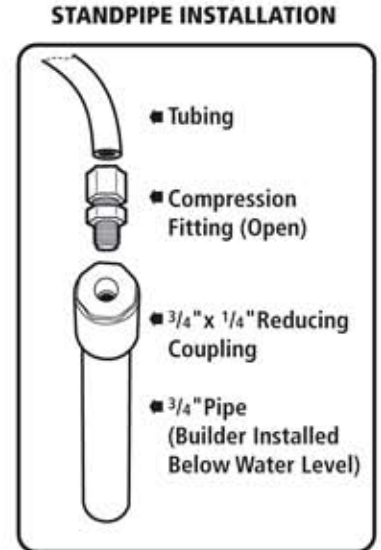


# UltraPure Pool Ozone Generators Installation Schematics

(Shows Two Alternatives – the Retrofit and Stand Pipe Methods)

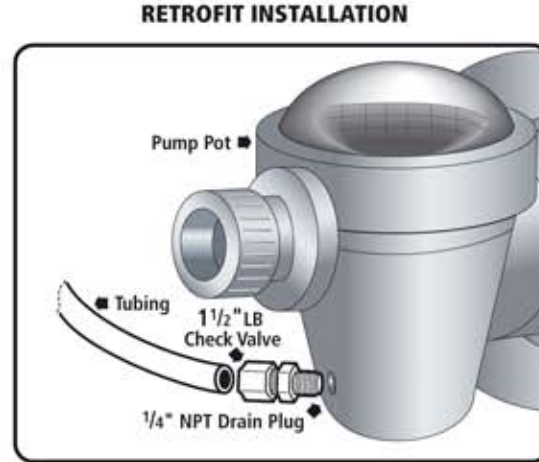

**Notes**

**Standpipe Installation**

- No Check Valve Required since the connection is below water level.
- Is Virtually Fail Safe.

**Retrofit Installation**

- Requires 1 1/2 Lb. Check Valve.
- Stronger Check Valve is required on installations over 3' above water level.

**External Safety Air Bleed Kit**

ESABK is designed to take air from the top of the filter and send it downstream (up to 15') past all equipment.

